


Final Tidal Zoning for S-B916-NRT5-2010, F00596 Hudson River - South of Stockport Middle Ground

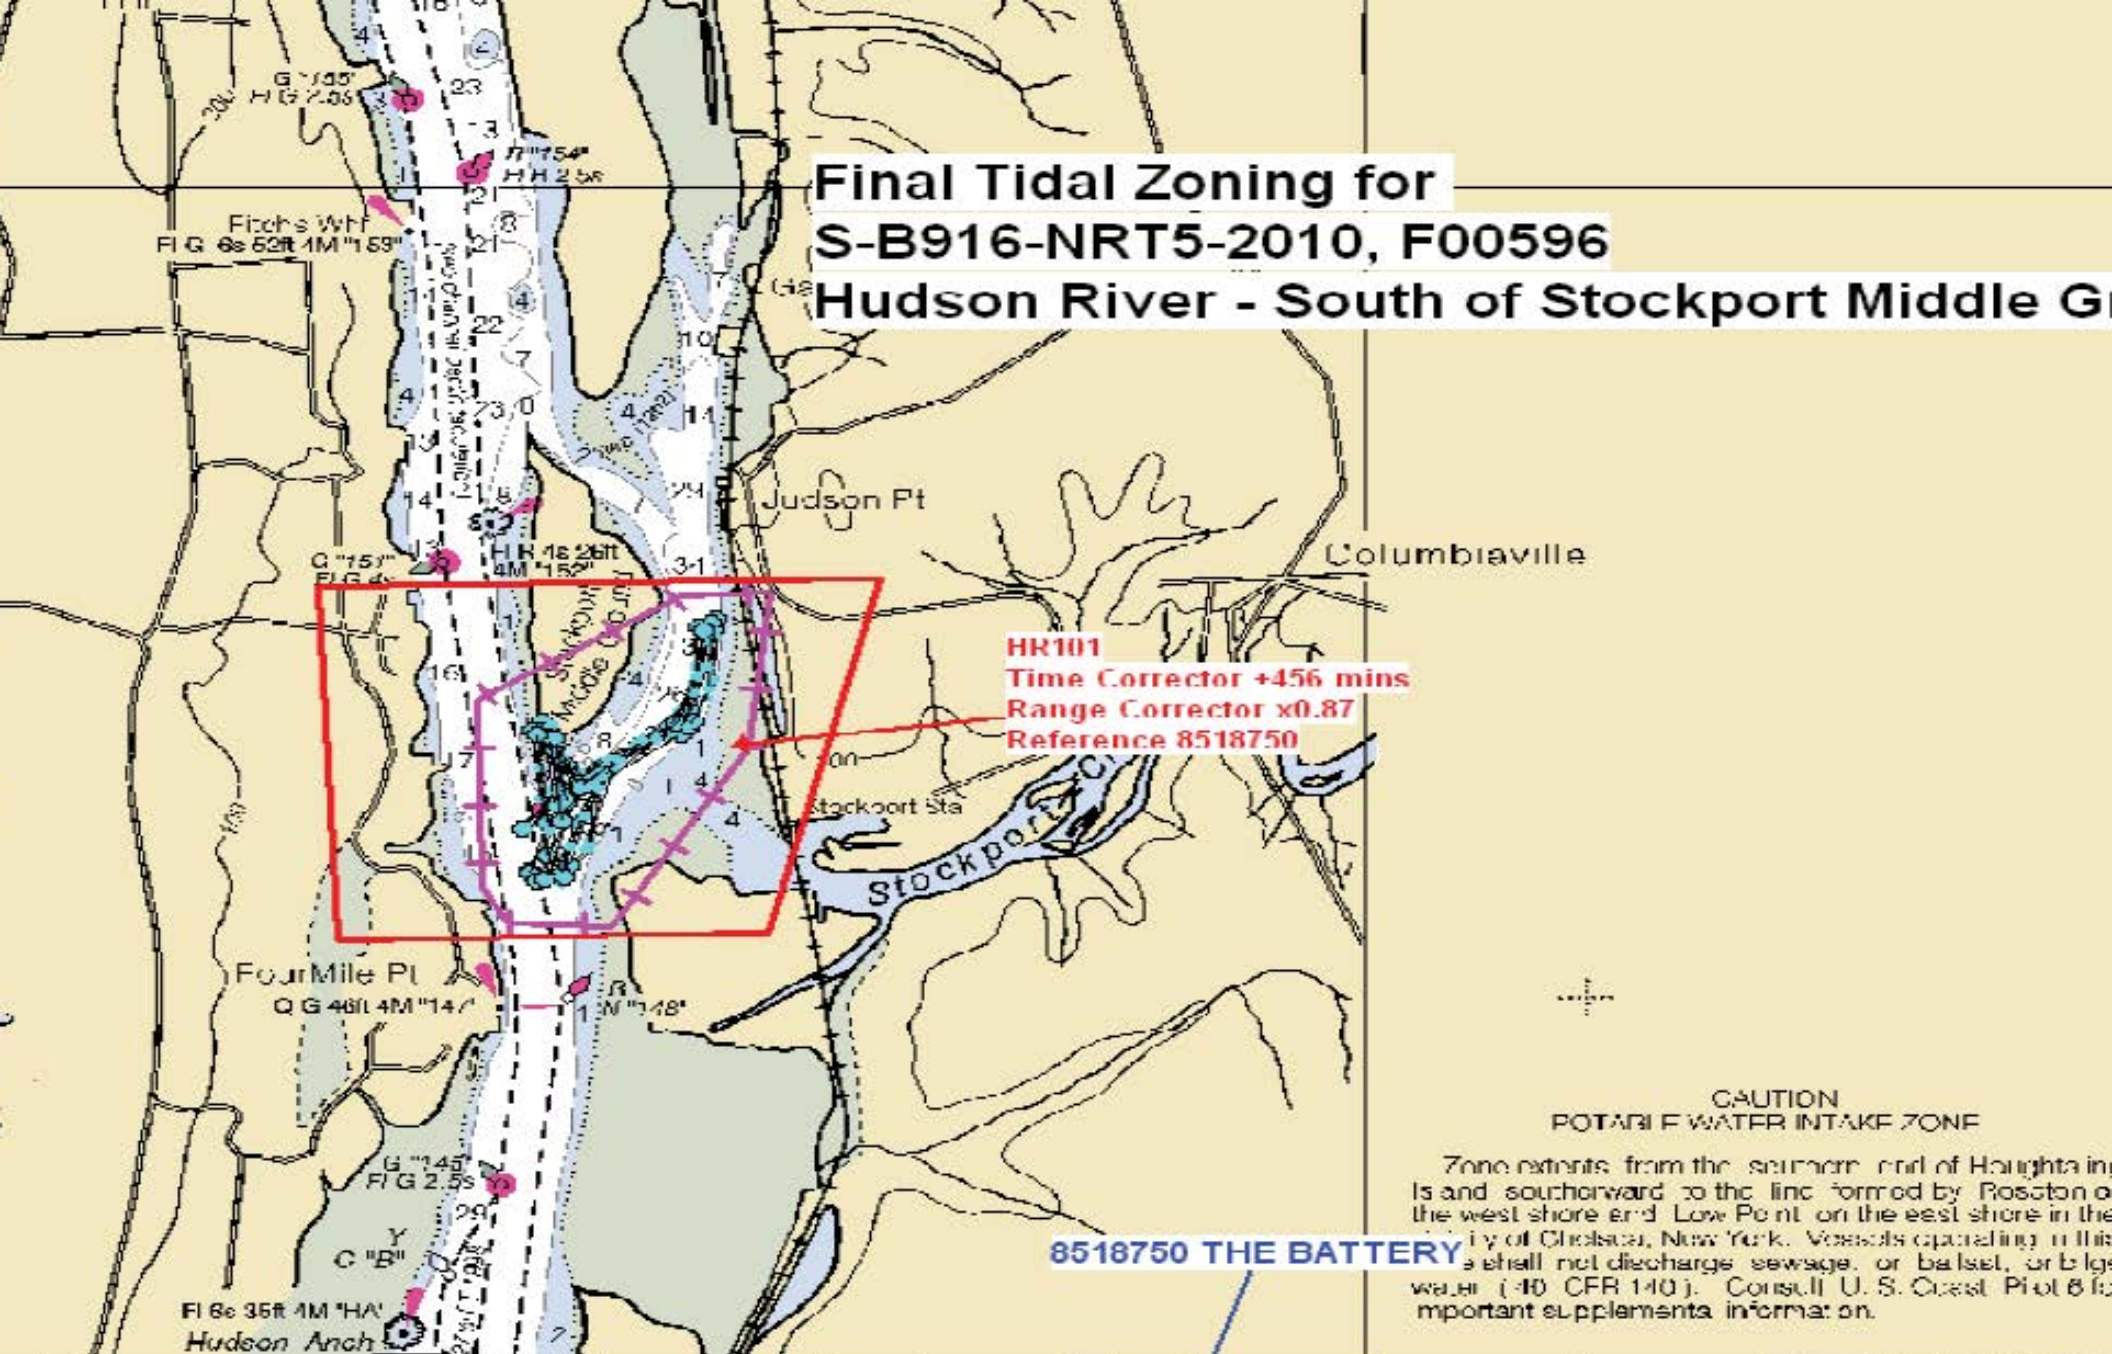

HR101
Time Corrector +456 mins
Range Corrector x0.87
Reference 8518750

8518750 THE BATTERY

CAUTION
POTABLE WATER INTAKE ZONE

Zone extends from the southern end of Houghtaling Is and southward to the line formed by Roseton on the west shore and Low Point on the east shore in the City of Chelsea, New York. Vessels operating in this area shall not discharge sewage, or ballast, or bilge water (10 CFR 140). Consult U. S. Coast Pilot 8 for important supplemental information.

JOINS CHART 129/7

73° 45'

CAUTION

It has been corrected from the Notice to Mariners published weekly by the Imagery and Mapping Agency and the Local Notice to Mariners published by each U.S. Coast Guard District, to the date shown in the red corner.

PLB1151
 U.S. DEPARTMENT OF COMMERCE
 NATIONAL OCEANIC AND ATMOSPHERIC ADMINISTRATION
 NATIONAL TIDAL DATUM